

HUMIDIFIER

HU-150G

USER MANUAL





Contronics Engineering B.V., Ambachtsweg 8, 5492 NJ Sint-Oedenrode, The Netherlands, hereby declares that product HU-15OG, produced and delivered by Contronics Engineering B.V., is in accordance with the following CE directives:

EMC-Directive	:	2014/30/EU
Directive for low-voltage electrical installation	:	2014/35/EU
RoHS-Directive	:	2011/65/EU

Table of contents

1. PREFACE	4
2. INTRODUCTION	5
3. SAFETY REGULATIONS	6
4. PACKING	6
5. CONNECTIONS AND FUNCTIONS	7
6. INSTALLATION INSTRUCTIONS	8
7. ELECTRICAL CONNECTIONS	9
8. WATER CONNECTIONS AND FLUSHING CYCLE	10
9. AIR CONNECTIONS	11
10. SWITCHING ON AND STARTING UP/FUNCTIONAL TEST	11
11. OZONE GENERATOR	13
12. MAINTENANCE	14
13. MAINTENANCE OF THE OZONE GENERATOR	14
14. REPLACING SPARE PARTS	15
15. APPLICATIONS OF THE HUMIDIFIER	15
16. MENU OVERVIEW	16
17. FACTORY SETTING AND RANGE	18
18. MALFUNCTIONS	19
19. TECHNICAL SPECIFICATIONS	20

1. PREFACE

This user manual contains the operating, installation and maintenance instructions for the ultrasonic humidifier HU-150G.

WARNING

It is possible that bacteria could be present in the humidifier's water supply. Some bacteria (Legionella) could be harmful to health if they are present in the aerosols that are blown out by the humidifier.

Through the construction, flushing programme and materials used, Contronics has ensured that the stimulation of bacterial growth is kept to the absolute minimum. In order to ensure the supply of pure water, it is strongly recommended that demineralised water is used (see the Contronics product range). In conditions where bacterial pollution could occur in the surrounding air (e.g. at meat counters) or in areas where hot ambient air could arise (e.g. bakeries), it is also recommended to incorporate an ozone generator in the air supply system (see the Contronics product range). Contronics cannot be held liable for any harm caused by bacteria or micro-organisms. It is the responsibility of the user to regularly carry out maintenance and to check the quality of the supplied water.

WARNING

It is possible that bacteria could be present in the humidifier's water supply. Some bacteria (Legionella) could be harmful to health if they are present in the aerosols that are blown out by the humidifier.

2. INTRODUCTION

Principle of ultrasonic air humidification

Minute water droplets with a size of 1 to 3 microns are ejected above the water surface by means of high-frequency vibrations (1.7 MHz). The humidifier's air movement system ensures that these water droplets are then blown into the area to be humidified. The major advantages of this humidifier are the very low energy consumption, the limited amount of maintenance required and the low noise level.

Continuously-variable air humidity control (CVH)

The humidifier has a dial with which the capacity can be regulated between 0 and the maximum per hour. If a humidity sensor has been connected to the humidifier, the desired humidity can be set between 35% and 95% using the same dial. The CVH system will then control the humidity proportional to the set value. The humidifier is therefore continuously in operation and ensures that the relative humidity is maintained at the set value. Instead of controlling the humidity with a humidity sensor, it is also possible to control the humidifier externally (0-10V), for example by using the DZR-45 and HTR-10 controllers.

Capacity

There is no limit to the modular expansion of the HU and this can be carried out as and when needed. This means that an unlimited number of modules can be linked together to form one system, thus allowing the capacity to be increased. As a result of the very high frequency of 1.7 MHz, the water droplets are minute, causing them to evaporate quickly and thereby cause less condensation in the humidifier's distribution pipes on their way towards the area to be humidified.

Water quality

Even though the humidifier itself can be connected to plain tap water up to 8° German hardness, Contronics recommends demineralised water. This will limit the maintenance of the device to a minimum and the service life of the transducer will be considerably extended.

This will also prevent certain substances that are contained in tap water, such as calcium, salts, minerals and bacteria, ending up in the area to be humidified. Contronics has various filters available in its product range, operating on the basis of reverse osmosis. (See also the warning on page 4).

Disinfection

For situations where bacterial purity is necessary (food industry) it is possible to connect an ozone generator. Contronics has an ozone generator in its delivery program.

3. SAFETY REGULATIONS

IMPORTANT

The humidifier has an open water tank. Any overflow of the water tank could damage the electronics inside the humidifier.

The following measures must always be observed:

- Always disconnect the 230 V mains voltage from the humidifier before moving it and/or carrying out maintenance activities.
- Always keep the humidifier horizontal and motionless while it is in operation and for up to 2 minutes afterwards.
- Ensure that the water is always discharged via the outlet and ensure that this is never blocked.
- The humidifier may only be dismantled by authorized Contronics technicians.

4. PACKING

The HU is delivered in recyclable packaging that should be kept for re-shipping the unit for maintenance activities. Any shipment using other packaging could cause damage to the HU for which the manufacturer cannot be held liable.

It is possible that some traces of water could be found in the packaging; all the functions of the HU are thoroughly tested during the quality control and, for this reason, some water could still remain in the HU before it is packed.

The package contains:

- HU humidifier.
- Power cord.
- Instructions for use.
- PVC connection to 40 mm.

5. CONNECTIONS AND FUNCTIONS

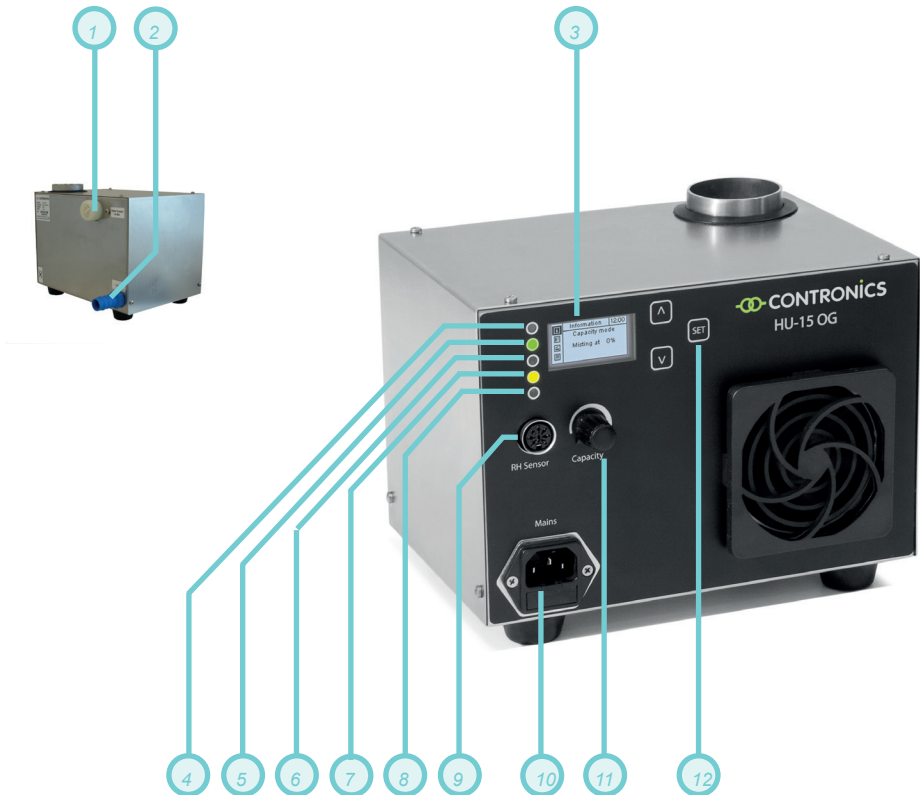


Figure 1 Connections and functions

1. Water supply 3/4", min. 1 bar / max. 6 bar.
2. Water discharge 15 mm free passage.
3. Display.
4. LED indication (blue) constant for adjustment of the capacity. (Flashing --> ozone)
5. LED indication (green) for rinsing.
6. High level LED indication (yellow).
7. Low level LED indication (yellow).
8. High temperature LED indication (red).
9. Connection plug for HS-91, DZR-45, HTR-10, HK-15 or HK-01 (external control 0-10 V).
10. Mains voltage connection + fuse (230 V \pm 10% / 50-60 Hz.).
11. Rotary button for adjustment of the capacity/humidity.
12. Push buttons for adjustments.

IMPORTANT

The guarantee will become void if the humidifier is installed incorrectly or if it is handled in an improper manner.

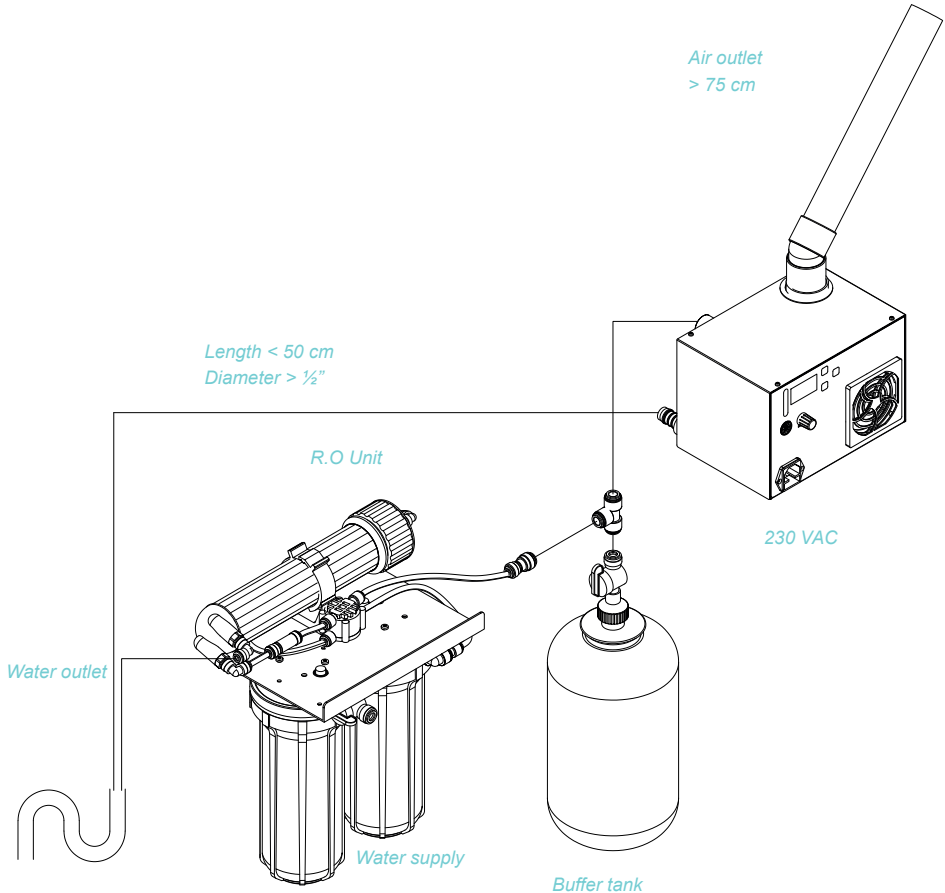


Figure 2 General set-up

1. Place the humidifier in an environment with a temperature between 0°C and 35°C and humidity < 100%.
2. Place the humidifier in a level position (2-dimensional).
3. Never place the humidifier on a closed tray with raised edges.

7. ELECTRICAL CONNECTIONS

Supply voltage (230V AC \pm 10%)

Ensure there is an earthed wall socket next to the humidifier. If necessary, connect it in parallel to any external ventilators. This will ensure that the ventilators and the humidifier switch on and off simultaneously.

Sensor connection

Mount the sensor in a suitable place (for measuring) and connect the DIN plug to the humidifier.

External control voltage

The HU can be controlled via an external control voltage (0-10 Volt). Use the HK-01 cable for this purpose. The DIN plug is connected to the humidifier, which can then be controlled using a direct current of 0 Volt (min.) up to 10 Volt (max.).

IMPORTANT

The external control signal must be floating with respect to earth (there must never be a connection to “earth”). The output impedance of the external control signal must be $< 470\Omega$.

It is also possible to set up an On/Off control. To do this, use the HK-15 cable. Short circuiting the two wires will cause the humidifier to immediately operate at the capacity set by the rotary button. The humidifier will be in stand-by mode when the contact is opened, and will not humidify.

IMPORTANT

If an external controller has been connected to the DIN plug, the dial on the humidifier must be set to 0. This will prevent the humidifier from humidifying if a fault occurs in the controller.

8. WATER CONNECTIONS AND FLUSHING CYCLE

IMPORTANT

Thoroughly flush out the piping before connecting the humidifier in order to prevent installation debris from blocking the intake valve.

Water supply

The humidifier has an integrated flow-reduction valve and can handle a water pressure from a minimum of 1 bar to a maximum of 6 bar. The water level in the humidifier is controlled by a pressure sensor and a solenoid valve.

The HU-150G is provided with protection. This protection starts to work when the water supply is closed off or does not work. The water valve is then closed to prevent damage to the water valve. It can take up to 2 minutes before the appliance fills with water again after the water supply has been restored.

Demineralised (R.O.) water must be used for the humidifier and will provide adequate protection against bacteria. The use of plain tap water will lead to faster contamination of the water tank and transducers, which will result in a shorter service life. Moreover, the dissolved calcium and mineral particles in ordinary tap water will be blown into the area to be humidified together with the fog droplets and will be precipitated in the area. Depending on the hardness of the water, this could cause a layer of dust after only a few days (see also the warning on page 4).

Water discharge

Connect a hose with a maximum length of 50 cm and a minimum diameter of 1/2" to the humidifier's water discharge connection point so that any excess water can be discharged from the humidifier. The outlet of this hose or pipe must be free; the end may not be hanging in the water (see Figure 2). The water discharge from the humidifier is unpressurised.

IMPORTANT

The water discharge connection point on the humidifier must constitute the highest point on the water discharge channel. The water discharge is not pressurised. A blocked outlet could damage the humidifier.

A blocked water discharge channel could cause the humidifier to overflow. For this reason, never place the humidifier on a tray with raised edges as this could cause damage to the humidifier for which the manufacturer cannot be held liable.

Flushing

The standard factory setting for the flushing cycle is once every hour. This may not be suitable for some applications. In these cases, the flushing cycle can be modified. (See the menu overview on pages 16-17).

Standard cycle

The humidifier's "flushing/alarm" LED will light up every hour. The device will start the flushing cycle:

- The fogging will stop.
- The water tank will be flushed for approx. 15 seconds (depending on the water pressure).
- The water will be discharged.
- The humidifier will be re-filled and will restart normal operation.
- The green LED will blink while this procedure is taking place.

If the humidifier is switched off (230V supply voltage switched off), the water content will be discharged.

9. AIR CONNECTIONS

Air supply

Ensure a clean air supply without water droplets.

Air outlet

The air outlet must always be extended by a 75 cm pipe to allow larger droplets to be captured. Mount the outlet so that it slopes towards the humidifier to ensure that any condensed fog can flow back.

The connected pipe must be free from dust, dirt and oil residues. The length of the air outlet channel to the outlet may not exceed 4 m with a diameter that remains the same.

10. SWITCHING ON AND STARTING UP/FUNCTIONAL TEST

Switching on

Check the following before the humidifier is switched on for the first time:

- The humidifier is positioned level.
- All pipes have been properly connected.
- The mains voltage is correct and connected in parallel with any ventilators that are used.
- The water discharge channel has been connected according to the instructions.
- The water supply has been connected according to the instructions. The water piping has been flushed in order to prevent any installation debris blocking the water valve.

IMPORTANT

Never switch the mains voltage on if the humidifier is not in the correct position or if it is placed upside-down, as this would cause the transducer to burn.

Start up and functional test

- Open the water valve
- Set the % RH knob on maximum position
- Switch on the power and check if:
 - a. The water runs to the humidifier.
 - b. The water flow stops after about 60 seconds.
 - c. The production of mist starts after a few seconds.
- Switch off the power and check if:
 - a. The water content is drained away.
 - b. After about 1 minute the water reservoir is emptied completely.
- Connect the water drain and check for leakages.
- Switch on the main supply again.
- Set the % knob in the desired position.
- Control if necessary the airdspeed. (See the menu overview on pages 16-17).

Note: During start up and flushing (water filling) of the humidifier the LED "Flushing/alarm" will blink green. This is a normal indication on the humidifier during this procedure.

IMPORTANT

If the humidifier becomes overheated it will switch off. Once it has cooled down it will automatically switch on again. In case of overheating, the "Alarm" LED will show red. (See figure 1 /8).

The following conditions could cause overheating:

- **A blockage in the air inlet.**
- **A blockage in the air outlet.**
- **Air intake temperature too high.**
- **Water temperature too high.**
- **Water discharge blocked.**
- **Ambient temperature too high.**
- **Ventilator speed set too low.**

High Level

The humidification will stop if the water level in the humidifier becomes too high. The High Level LED will be activated. The drain valve will open in order to discharge the excess water.

Low Level

The humidification will stop if the water level in the humidifier becomes too low. The Low Level LED will be activated.

11. OZONE GENERATOR

The unit contains an integrated ozone generator. Ozone ensures that any bacteria that are present in the humidifier and the connected piping will be destroyed.

Ozone only takes effect, however, if the humidification is switched off while the ozone generation is taking place. A programmable timer has been incorporated in the humidifier for switching the ozone generation on and off. Contronics sets this timer to a default setting of 2 hours of ozone generation between 2.00 a.m. and 4.00 a.m. while the humidification is switched off. This setting can be changed (see menu overview). If the blue LED indicator is flashing, ozone is generated.

WARNING

Ozone could be harmful to your health if the gas is inhaled over a longer period of time in a higher concentration. However, this concentration only occurs inside the humidifier and the connected piping. Once discharged, ozone gas quickly breaks down into ordinary oxygen, without any residual products.

The timer is independent of the mains supply and has a battery incorporated in the ozone module for this purpose.

WARNING

If these batteries have to be replaced, the old battery must be disposed off as chemical waste or, alternatively, returned to the manufacturer. After replacing the battery it is possible that the message "Low Battery" and "Check Time" appears. Mains voltage off and immediately back on. The message disappears. Set the time clock.

12. MAINTENANCE

IMPORTANT

All maintenance must be carried out by Contronics or by an organisation authorized by Contronics.

Regular maintenance is important for the optimum operation of the humidifier and to maintain hygiene.

The yearly maintenance of the water reservoir will depend on the quality of the water and the purity of the air that is sucked in. The transducer must be replaced after approximately 20,000 operating hours (i.e. after about 2 years in the case of continuous use).

IMPORTANT

Make sure that the transducer is not damaged during cleaning.

Check the following before starting maintenance or shipping the humidifier:

- The mains plug has been removed from the socket and the ventilator is not moving.
- The water supply has been closed.
- The water supply pipe has been removed.
- The humidity sensor plug has been removed.
- The water reservoir is empty and the water discharge hose has been removed.
- The humidifier remains horizontal while dismantling.

Cleaning

- Clean the reservoir with a soft brush or cloth.

In the case of calcium scale, the reservoir can be filled with household vinegar. Allow to soak for 4-12 hours then clean with a soft brush and flush through. Remove the filter from the water inlet. Clean the filter or replace it with a new one. Flush the water discharge with water and clean it with a round brush.

13. MAINTENANCE OF THE OZONE GENERATOR

The ceramic element must be cleaned once a year:


- The humidifier must be disconnected from the mains.
- Remove the screws from the top cover (8 screws) and remove the top cover.
- Remove the 4 screws from the cover of the ceramic element housing.
- Remove the ceramic elements from the housing.
- Remove the ceramic elements from the holder.
- Carefully clean the ceramic elements on two sides with cleaning spirit or alcohol.
- If the vapour-deposited metal on the ceramic element has cracks: replace the ceramic element.
- Re-assembly takes place in reverse order.



Remove 4 screws from the cover of the ceramic element housing.



Remove Ceramic element from the housing.

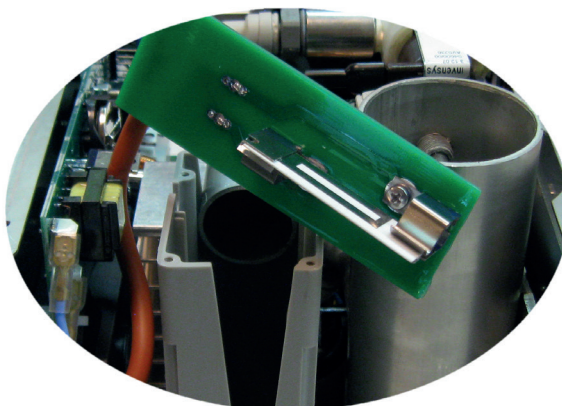

Remove ceramic plate from the holder.

14. REPLACING SPARE PARTS

Replacing the transducers







The replacement of the transducers can only be done by Contronics or representatives authorised by Contronics.

15. APPLICATIONS OF THE HUMIDIFIER





Various information sheets and drawings are available covering different applications. These can be downloaded from www.contronics.nl.

16. MENU OVERVIEW

Settings





- Scroll to the desired setting using the  or  button.
- Press  to confirm the selection.
- Scroll using the button  or  to <<<<.
- Press  to leave the menu.

Screen display after switching on:

	Information	12:00
	Capacity mode	
	Misting at	0%
		

The current status will be displayed on the screen after the mains voltage has been switched on. The top line indicates whether a humidity sensor (HS-91P) is connected or not. The second line indicates the fogging output. The bottom line provides information on the water level.

Screen display after the sensor has been connected:

	Information	12:00
	Hygrostat mode	
	Sensor	36%
	Misting at	0%
	Setpoint	0%

The HU-15 will switch to hygrostat mode when a humidity sensor (HS-91P) is connected. The display will show the sensor value, the set value and the released fogging capacity.

OZONE MENU:

- Setting the time at which the ozone generation is switched on and the humidification switched off (2 blocks are possible).
- Setting for ozone on, off or timer-controlled.

HUMIDIFICATION MENU:

- Adjusting the rinsing cycle.
- Setting the RH bandwidth.
- Setting the RH offset.

DISPLAY MENU:

- Setting the language.
- Setting the contrast.
- Setting the timer.
- Service to software version and return to factory settings.



Information
Capacity mode
Not activated
No water



OG settings — Time settings — Start 1
— Stop 1
— Start 2
— Stop 2
— <<<<<<
— Ozone settings — On
— Timer
— Off
— <<<<<<



HU settings — Flushing cycle — Timer
— Hygrostat — RH Bandwidth
— RH Shift
— <<<<<<
— Fan — Fan speed
— Continuous ventilation — On
— Off
— <<<<<<
— Max. capacity — Percentage
— <<<<<<




LCD settings — Language — English
— Dutch
— German
— Percentage
— LCD contrast
— Setting the timer
— Service — Software version
— Factory settings — Not adjustable
— Installer service
— Factory menu — Not adjustable
— <<<<<<

17. FACTORY SETTING AND RANGE

Parameter			Max.	Min.	Factory setting	Unit
OG settings	Time settings	Start 1	23.59	00:00	02:00	hours-min.
		Stop 1	23.59	00:00	04:00	hours-min.
		Start 2	23.59	00:00	00:00	hours-min.
		Stop 2	23.59	00:00	00:00	hours-min.
	Ozone settings				Clock	
HU settings	Timer flushing cycle		1.440	60	60	min.
	Hygrostat	RH band-width	20	1	10	%
		RH shift	30	-9	0	%
	Ventilator	Vent. speed	100	10	100	%
		Continuous ventil.			Off	
	Max. capacity					%
LCD settings	Contrast					%

18. MALFUNCTIONS

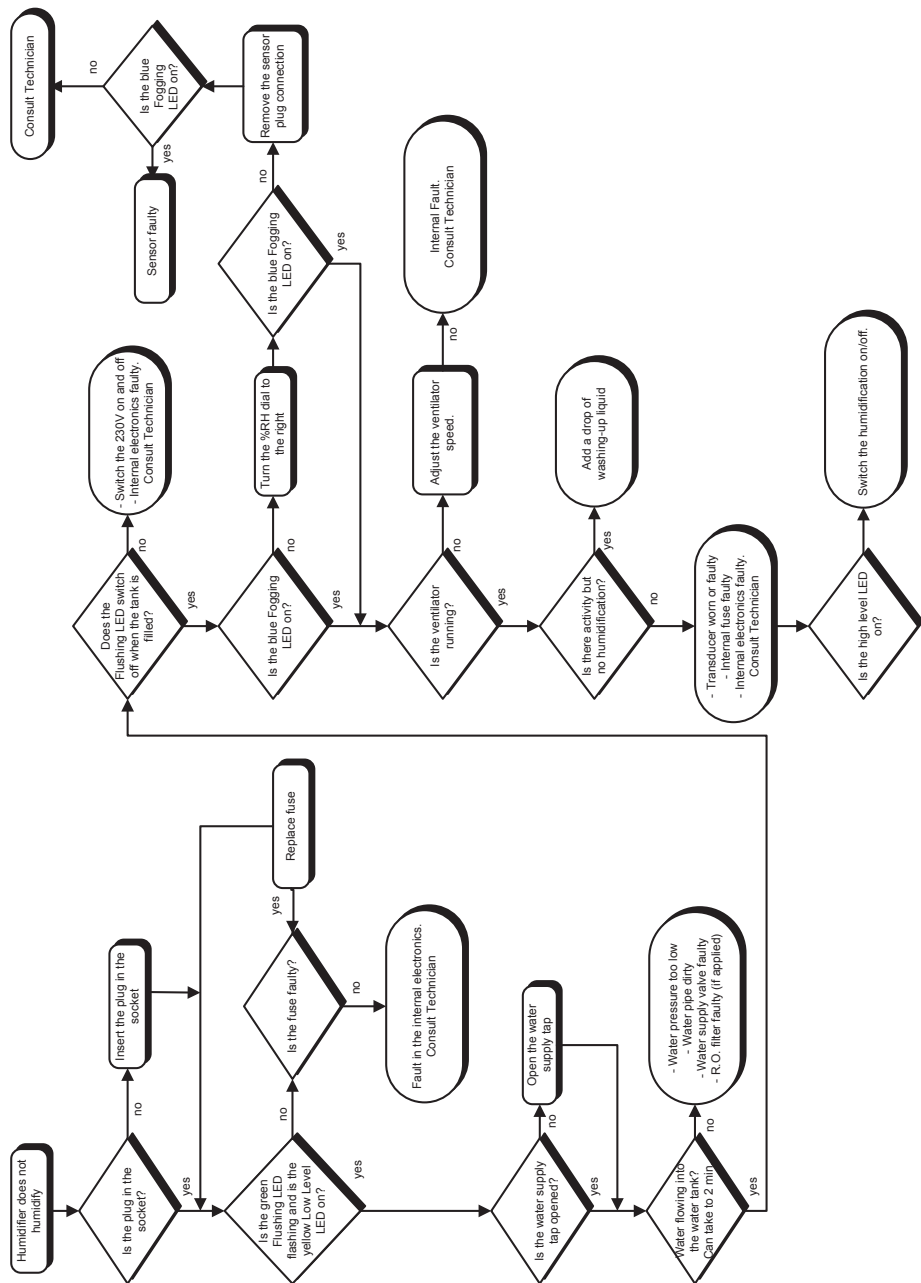

19. TECHNICAL SPECIFICATIONS

	HU-150G
Transducer frequency	1,7 MHz
Maximum capacity	0-0,5 kg/hour (adjustable)
Service life of the transducers	10.000-20.000 hours
Size of the water droplets	1-3 micron
Diameter of outlet flange	1 x 40 mm
Diameter of suction flange	80 mm
Air flow	adjustable (0-20 m ³ 0 Pa)
Outlet pipe length	4 meter
Water pressure	1-6 bar
Water connection	3/4" external
Maximum water hardness	8° German hardness (demineralised water strongly recommended)
Flushing frequency	1x per hour (adjustable)
Water discharge	15 mm external
Content of water tank	100 cm ³
Mains voltage	230V ± 10% 50/60 Hz
Power consumption	60 W
Ambient temperature	0 °C - 35 °C
Water temperature	0 °C - 15 °C
Ambient temperature compared to supply air temperature	Non condensing
Dimensions (LxWxH)	220 x 150 x 150 mm
Housing	Stainless steel 316L
Weight	4 kg

Ozongenerator

Capacity ozone	20 mg/hour
Controlling ozone	Via timer with day programming

DISCLAIMER

Contronics works continuously on the further development of its humidifiers. We therefore reserve the right to modify the design, construction and technology of the product at any time. For this reason, no claims can be made based on the data, illustrations and description in this user manual.

Additional, up-to-date information is available on www.contronics.nl.

HU-150G

HU-150G